



**1570B
AMPLIFIER**

**OPERATING
INSTRUCTIONS**



SPECIFICATIONS

| | |
|----------------------------|--|
| Type: | Power Amplifier |
| Gain: | 72 db |
| Input Sensitivity: | 1.0 volt rms for rated output |
| Power Output: | 175 watts at less than 5% thd, 65-20,000 cps 165 watts at less than 3% thd, 70-10,000 cps |
| Frequency Response: | ± 1.0 db, 10-50,000 cps |
| Input Impedance: | 70,000 ohm potentiometer |
| Source Impedance: | 150, 600 ohms with 15095 Plug-in Transformer |
| Load Impedance: | 8 (35v), 16 (50 v), 32 (70 v) ohms |
| Output Impedance: | Less than 10% of nominal load impedance |
| Noise Level: | Output noise -25 dbm: 77 db below rated output |
| Controls: | Volume control, continuously variable composition |
| Power Supply: | 105-130 volts, 60 cps, 350 watts |
| Tubes: | 1-12AX7, 1-6SN7GTB, 2-6W6GT, 2-811-A, 4-5R4GY |
| Dimensions: | 10 1/2" H, 19" W, 13 1/2" D |
| Color: | Green |
| Weight: | 59 lbs. |
| Accessories: | 15095 Plug-in Transformer 10399 Panel |



A Division of *BSV* Ling Altec, Inc.
©Altec Lansing

1515 S. Manchester Ave., Anaheim, Calif.
New York

12969-1

PRICE \$.14

LITHO IN U.S.A.

11/65

GENERAL DESCRIPTION

The 1570B Amplifier is a compact, high quality, 165 watt power amplifier designed for public address applications, either shelf or rack mount. Rack mounting occupies six units (10 1/2") of rack space. Negative feedback is carried around all stages from a tertiary winding on the heavy duty output transformer, permitting the output to feed an ungrounded load or a load with one side grounded. This amplifier is designed for stable 70 volt line operation under all output load conditions without impairment of program quality. Power switch, pilot light and gain control are located on the front of the amplifier and the input and output terminals, in the form of barrier type terminal blocks, are mounted on the rear. A six-foot three-wire power cord, terminating in a three-pin cap, is standard equipment with this amplifier.

A special protective device is incorporated in the 1570B in the form of a thermal circuit breaker shunted by a power resistor, the combination being in series with one side of the power transformer primary. The breaker is fastened to the amplifier chassis so that heat from the latter is transferred to the breaker thermal element. AC line current through the breaker also heats the thermal element. Abnormal heating of the chassis and abnormal line current will make the breaker contacts open, inserting the power resistor in series with the power transformer primary reducing the voltage to it. Program service is thus maintained at reduced power. The breaker being an automatic reset type, reduction in line current and chassis temperature will allow it to close and restore full line voltage to the power transformer. Cycling will continue until the abnormal condition is corrected. Locating the amplifier in an inadequately ventilated, high ambient temperature zone will result in excessive heating. Overdriving the amplifier due to a mismatch of load to amplifier output will result in abnormal line current.

INSTALLATION


When mounting 1570B Amplifiers in a standard rack or cabinet rack, use a minimum of one rack unit (1 3/4") spacing between amplifiers and fill space with the 10399 perforated panel. When cabinet racks are used, a blower of approximately 40 cfm capacity should be installed on top of the cabinet to exhaust hot air from within the cabinet. Fresh air is thus drawn into the amplifier chassis through the front grill openings.

INPUT CONNECTIONS

Two pairs of input terminals are provided. Terminals 1 and 2, which connect directly to the input potentiometer, are provided for unbalanced high impedance sources or for bridging unbalanced low impedance lines having a signal voltage of 1 volt or more. Terminals 3 and 4 connect to a standard octal socket which permits low impedance input from balanced or unbalanced lines of 150 or 600 ohms with the accessory 15095 (plug-in) Line Transformer. The socket is connected for 600 ohm operation as shipped. The 150 ohm input is obtained by strapping the socket terminals as shown on the schematic. Both inputs may be used simultaneously provided the input to 1 and 2 is built out with a 100,000 ohm resistor in series with the high side of the line to prevent excessive loading or shorting of the low impedance input.

OUTPUT CONNECTIONS

Output taps for nominal loads of 8, 16, and 32 ohms (70 volt line) are provided. Connections and strapping are shown below.

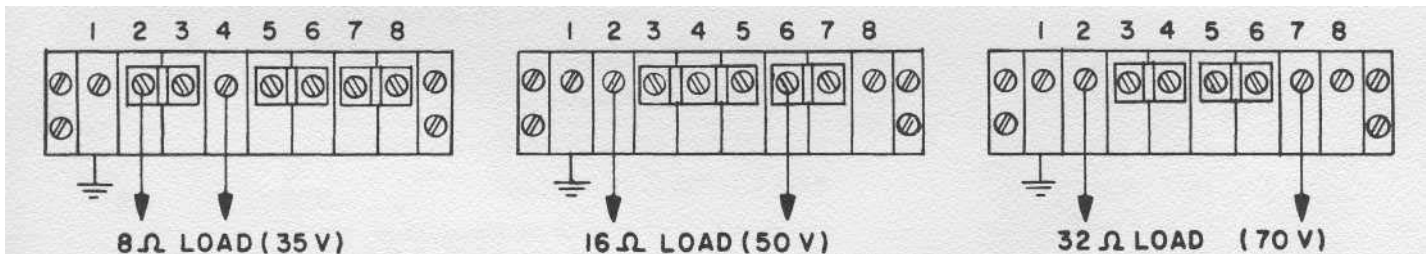

Speaker Matching: Use the output tap which most nearly equals the total speaker impedance. If the load impedance falls between two output tap values, use the lower tap.

70 Volt Line: The constant voltage distribution system (70 volt line) permits connection of a large number of speakers, each to operate at the power level desired, without regard for the impedance involved. In this system, each speaker is equipped with a transformer which has a number of taps rated in terms of power and the tap is selected which gives the desired speaker power. The total power required for the speakers should be equal to or less than the amplifier power rating.

Protection of Horn Loaded Drivers: In industrial paging systems, stadium, arena or other voice reinforcing systems which require excellent intelligibility over high noise levels, diaphragm type driver units coupled to horns are used. When these are used without loudspeaker dividing networks (used in two-way speaker systems), the low frequency energy applied to the driver voice coils must be limited. This protection is provided in the 1570B Amplifier by means of an R-C high pass filter in V-1 grid circuit (see schematic). As shipped, capacitors C9 and C10 are strapped out. By cutting one or both of these straps attenuation is introduced as shown in the table, depending on the impedance of the source.


| Source Impedance | Cut Strap | CPS | | | |
|---|-----------|---------|---------|--------|--------|
| | | 250 | 500 | 1000 | 2000 |
| 100,000 Ohm | B | -4.0 db | -1.5 db | -.5 db | -.2 db |
| | A | -3.0 | -1.0 | -.3 | -.2 |
| | A and B | -7.0 | -2.5 | -.8 | -.3 |
| Low (Approximately correct to 15,000 ohms) | B | -5.2 | -2.0 | -.7 | -.2 |
| | A | -8.5 | -4.0 | -1.5 | -.5 |
| | A and B | -12.5 | -6.2 | -2.5 | -.7 |

POWER CONNECTIONS

The power transformer of the 1570B Amplifier has primary taps for 117 and 128 volts and is shipped with the 128 volt tap (white lead) connected. Use of the 128 volt tap for all line conditions will extend component and tube life, reducing maintenance to a minimum. Do not connect the 117 volt tap unless 24-hour line checks show that the line does not exceed 117 volts. For your convenience, these two leads are equipped with ring type terminals, the one in use being connected to one terminal of the interlock microswitch and the unused terminal insulated with plastic tubing.

POWER OUTPUT

When making power output measurements, connect a jumper across the terminals of the thermal breaker. Continuous sine wave output in the full power range may operate the breaker, giving false readings, if the jumper is not used. In motor drive or other applications which require continuous sine wave full power output of the 1570B, the thermal breaker should likewise be bridged out of the circuit.

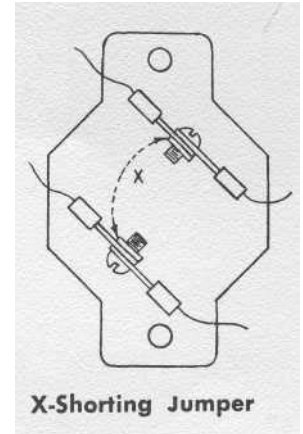


CONTROLS

Two controls are provided: Volume control and AC power switch. Provision has been made for mounting an accessory relay to provide plate power keying by remote control. The mounting holes are located near the center of the chassis and are suitable for a Potter-Brumfield type PR-3 relay or equivalent which should be mounted under the chassis. Select a relay having the desired coil voltage. If control wiring and microphone lines are carried in the same conduit, use a DC type relay. The white wire from the cable form to terminal 6 on V-9 tube socket should be transferred from this terminal to one contact on the relay. Connect the other relay contact to terminal 6, V-9 socket.


SERVICING

When the top cover is removed for tube replacement, etc., an interlock switch interrupts the AC line voltage to the power transformer. Do not attempt service work on this amplifier with AC line voltage on, as approximately 1,000 volt potentials occur at various points. Discharge all filter condensers before making continuity or resistance measurements. Routine servicing may then be done using the schematic for pertinent data reference. If high voltage measurements must be made, proceed with caution.

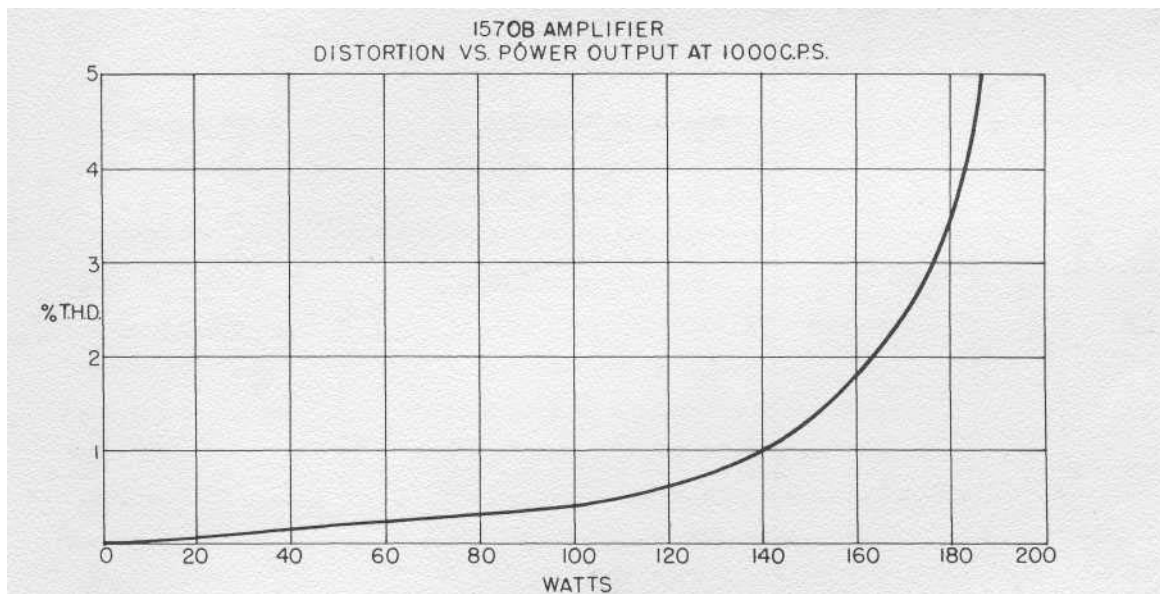

PARTS LIST

| | | | |
|------------------|--|--------------|--|
| C1 | .0002 mfd. $\pm 10\%$, 600v ceramic, Erie GP2-331 | R18 | 75,000 ohms, 20 watt, Ohmite Brown Devil |
| C2, 3 | .22 mfd., 400v, Astron BP4-22 | R19 | 5 ohms, 50 watt, Ohmite 0400A |
| C4, 5 | .1 mfd., 600v, CD PM6 P 1 | R20 | 10 ohms $\pm 10\%$, 1/2 watt |
| C6 | 40x40 mfd., 500v, Mallory FP288 | P1 | Altec Lansing 12435 |
| C7, 11 | 120 mfd., 200v, Mallory FP121 | BR1 | Klixon CA3 Thermal Breaker |
| C8 | 6 mfd., 1000v, Tobe-Deutschmann TAB-1006 | PL1 | G.E. Mazda #44 |
| C9 | .0056 mfd. $\pm 10\%$, 600 v ceramic, Erie 811 | T1 | Peerless 16492 |
| C10 | .0022 mfd. $\pm 10\%$, 600v ceramic, Erie GP-2 | T2 | Peerless 6410 |
| R1 | 1000 ohms $\pm 10\%$, 1/2 watt | L1 | Peerless 17173 |
| R2 | 330,000 ohms $\pm 5\%$, 1 watt | L2 | Peerless 17266 |
| R3, 21 | 100,000 ohms $\pm 10\%$, 1/2 watt | S1 | Altec Lansing 12763 |
| R4, 5, 9, 10, 17 | 100,000 ohms $\pm 10\%$, 1 watt | S2 | Interlock, V3-1 Microswitch |
| R6, 7 | 2.2 megohms $\pm 10\%$, 1/2 watt | RS1, 2 | G.E. 1N1695 Silicon Rectifier |
| R8 | 1800 ohms $\pm 10\%$, 1/2 watt | V1 | 12AX7 Vacuum Tube |
| R11, 12 | 330,000 ohms $\pm 10\%$, 1/2 watt | V2 | 6SN7GTB Vacuum Tube |
| R13 | 82,000 ohms $\pm 10\%$, 1/2 watt | V3, 4 | 6W6GT Vacuum Tube |
| R14 | 600 ohms, 5 watt, Ward Leonard Type 5 | V5, 6 | 811-A Vacuum Tube |
| R15, 16 | 100 ohms $\pm 10\%$, 1/2 watt | V7, 8, 9, 10 | 5R4GY Vacuum Tube |

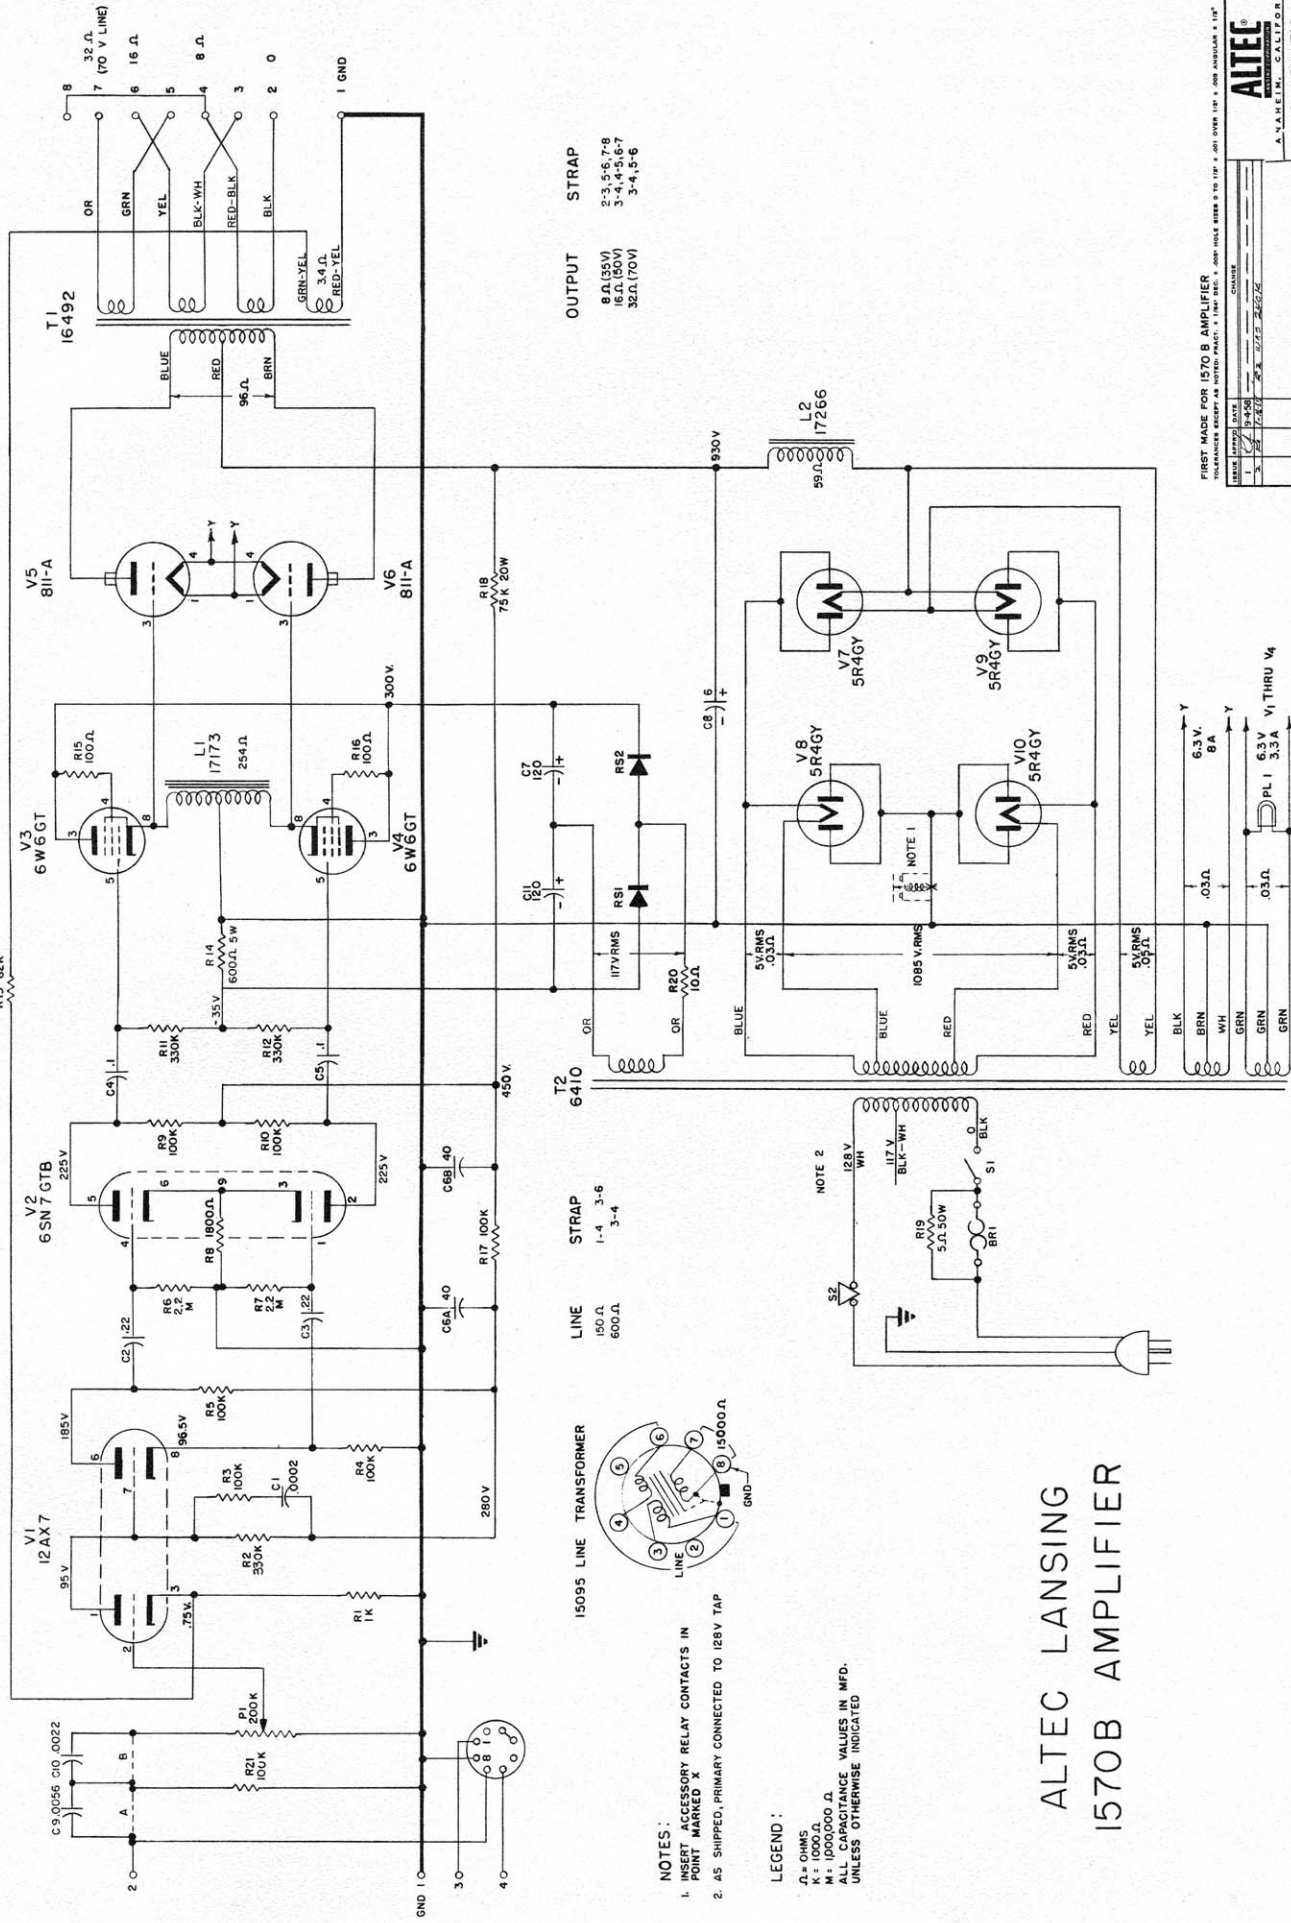

OUTPUT STRAP


8Ω (35V)
16Ω (50V)
32Ω (70V)

2-3, 5-6, 7-8
3-4, 4-5, 6-7
3-4, 5-6

LINE STRAP

150Ω
600Ω

15095 LINE TRANSFORMER



NOTES:

1. INSERT ACCESSORY RELAY CONTACTS IN POINT MARKED X
2. AS SHIPPED, PRIMARY CONNECTED TO 128V TAP

LEGEND:

Ω = OHMS
K = 1000Ω
M = 1000000Ω
ALL CAPACITANCE VALUES IN MFD.
UNLESS OTHERWISE INDICATED

**ALTEC LANSING
1570B AMPLIFIER**

FIRST MADE FOR 1570 B AMPLIFIER
INDICANCES EXCEPT AS NOTED ABOVE. 1. THIS INFO. 1.000 HOURS TEST @ 1.000 AMPERES @ 1.000°

| | | | | |
|---|---------|------|------|--------|
| 1 | 7/21/58 | 2173 | 2450 | CHANGE |
| 2 | 7/21/58 | 2173 | 2450 | CHANGE |
| 3 | 7/21/58 | 2173 | 2450 | CHANGE |

ALTEC
A. VAHREIM, CALIFORNIA
SCHEMATIC
1570 B AMPLIFIER
6697-2